

Inspection fee
150.00

+ Permit fee

COMPREHENSIVE INSPECTION AGENCY

71 Grove Street
Crassona, PA 17929
570-385-3010

POOL PERMIT INFORMATION

REQUIRED INFORMATION

- 1) A Plot Plan showing the proposed pool, equipment and fence with the distances to the side rear and front of property lines. Also, show locations of existing structures and septic system (if applicable). *Submit two (2) copies.*
- 2) POOL TYPE:
 - Above Ground: Submit one (1) copy of equipment specifications, pool style/sizes, fencing style/sizes (pool supplier can provide required information).
 - In Ground: Submit two (2) copies of pool construction drawings and one (1) copy of equipment specifications and fencing style/sizes.
 - Heated Pools: Submit one (1) copy of heater specifications.
 - Hot Tubs and Spas: Submit one (1) copy of tub/spa specifications, and UL listing of cover (if not protected by a fence).

NOTE: The information provided is a guideline and does not include all possible applications. Please contact your local code enforcement official or building inspector with questions.

WORK SHALL NOT PROCEED UNTIL REQUIRED FIELD INSPECTION HAS BEEN PERFORMED AND APPROVAL IS GIVEN BY COMPREHENSIVE INSPECTION AGENCY'S BUILDING INSPECTOR.


PLEASE SCHEDULE INSPECTIONS 24-HOURS IN ADVANCE – CALL (570) 573-2825.

COMPREHENSIVE INSPECTION AGENCY

71 Grove Street
Cressona, PA 17929
570-385-3010

❖ ELECTRICAL WIRING, GROUNDING and BONDING

- A GFCI-protected convenience receptacle is required between six (6') to twenty feet (20') zone from the pool.
- If the GFCI-protected pool equipment (e.g. pump) receptacle is located between six (6') to ten feet (10') from the pool, the receptacle must be a locking-type.
- Feeder wires shall be individual conductors and any wiring method employed shall contain an insulated copper equipment grounding conductor (minimum size: 12 AWG). The conductors are to be contained in PVC or metal conduit.
- Pool equipment/parts, any metal within five feet (5') of the pool and the pool water are required to be bonded to the pool. Minimum: 8 AWG solid copper wire conductor.
- Listed and labeled bonding connectors are required to be stainless steel, brass copper or copper alloy.

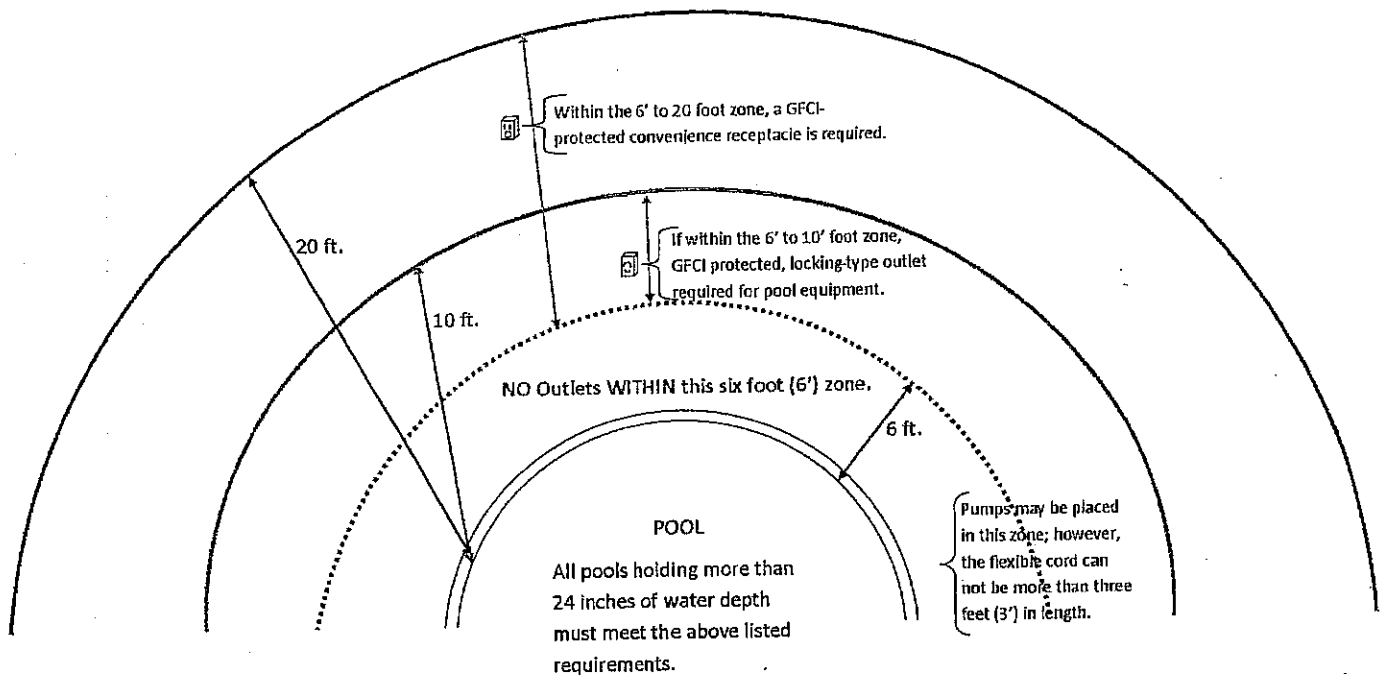

COMPREHENSIVE INSPECTION AGENCY

71 Grove Street
Cressona, PA 17929
570-385-3010

❖ FENCING and BARRIERS

- The pool must be surrounded by a barrier/fence. HEIGHT: four foot (4') minimum.
- When an exterior wall of a dwelling is used as a barrier, (1) the pool must be equipped with a powered safety cover, (2) any door with direct access must have an alarm that produces an audible warning when opened OR (3) other means of protection (e.g. self-closing and self-latching door).
- Any openings in the fence must be four inches (4") or less for vertical baluster-style and two and one-quarter inches (2 1/4") or less for mesh-type.
- Any access gates must open outward away from pool and be self-closing and self-latching.
- If the gate latch is less than fifty four inches (54") above the bottom of the gate, (a) the latch must be located on the pools side of the gate at least three inches (3") below the top of the gate, AND (b) the gate and the barrier shall have no opening greater than one-half inch (1/2") within eighteen inches (18") of the latch release mechanism.
- Where an ABOVE GROUND pool structure is used as a barrier or where the barrier is mounted on the top of the pool structure and the means of access is a ladder/steps, (1) the ladder/steps shall be capable of being secured/locked/removed to prevent access, OR (2) the ladder/steps shall be surrounded by a barrier.

COMPREHENSIVE INSPECTION AGENCY

71 Grove Street
Cressona, PA 17829
570-385-3010

ORDER OF INSPECTIONS

➤ ABOVE GROUND

❖ FINAL:

- Pool and barrier/fence must be complete
- Electrical systems and metal component bonding must be complete

➤ IN GROUND

❖ PRE-POUR:

- All rebar in place (check proper clearances)
- Rebar and equipotential bonding must be complete

❖ FINAL:

- Pool and barrier/fence must be complete
- Electrical systems and metal component bonding must be complete

WORK SHALL NOT PROCEED UNTIL REQUIRED FIELD INSPECTION HAS BEEN PERFORMED AND APPROVAL IS GIVEN BY COMPREHENSIVE INSPECTION AGENCY'S BUILDING INSPECTOR.

PLEASE SCHEDULE INSPECTIONS 24-HOURS IN ADVANCE – CALL (570) 573-2825.

NOTE: The information provided is a guideline and does not include all possible applications. Please contact your local code enforcement official or building inspector with questions.